


JOB NO 4793684	MODEL NUMBER SC-321110FP-SEP	DRAWN BY	SCHEMATIC TYPE INSTALL	DESCRIPTION OF OPERATION: 3 Phase w/ control for 2 Exhaust Fans, 1 Supply Fan, Exhaust on in Fire, Lights out in Fire, Fan(s) On/Off Thermostatically Controlled. Separate Breaker Input for each Fan. Room temperature sensor shipped loose for field installation. INVERTER DUTY 3 PHASE MOTOR REQUIRED FOR USE WITH VFD.
	JOB NAME Panda Express - Hamilton OH (...)	DATE 3/12/2021	DWG NO ECP #1-1	



<b>REVISIONS</b>	
DESCRIPTION	DATE:
Δ	
Δ	
Δ	
Δ	
Δ	
<p style="text-align: center;"><b>CAPTIVE</b></p> <p style="text-align: center;">Southern California Office www.captiveire.com</p> <p style="text-align: right;">3002 Dow Ave., Suite 410, Tustin, CA, 92780 PHONE: (714) 957-1500 FAX: (919) 227-5975 EMAIL: reg@captivae.com</p>	
Panda Express – Hamilton OH (D8193)	
HAMILTON, OH, 45011	
<b>DATE:</b> 3/12/2021	
<b>DWG.#:</b> 4793684	
<b>DRAWN BY:</b> AH–86	
<b>SCALE:</b> 3/4" = 1'–0"	
<b>MASTER DRAWING</b>	
<b>SHEET NO.</b>	
7	

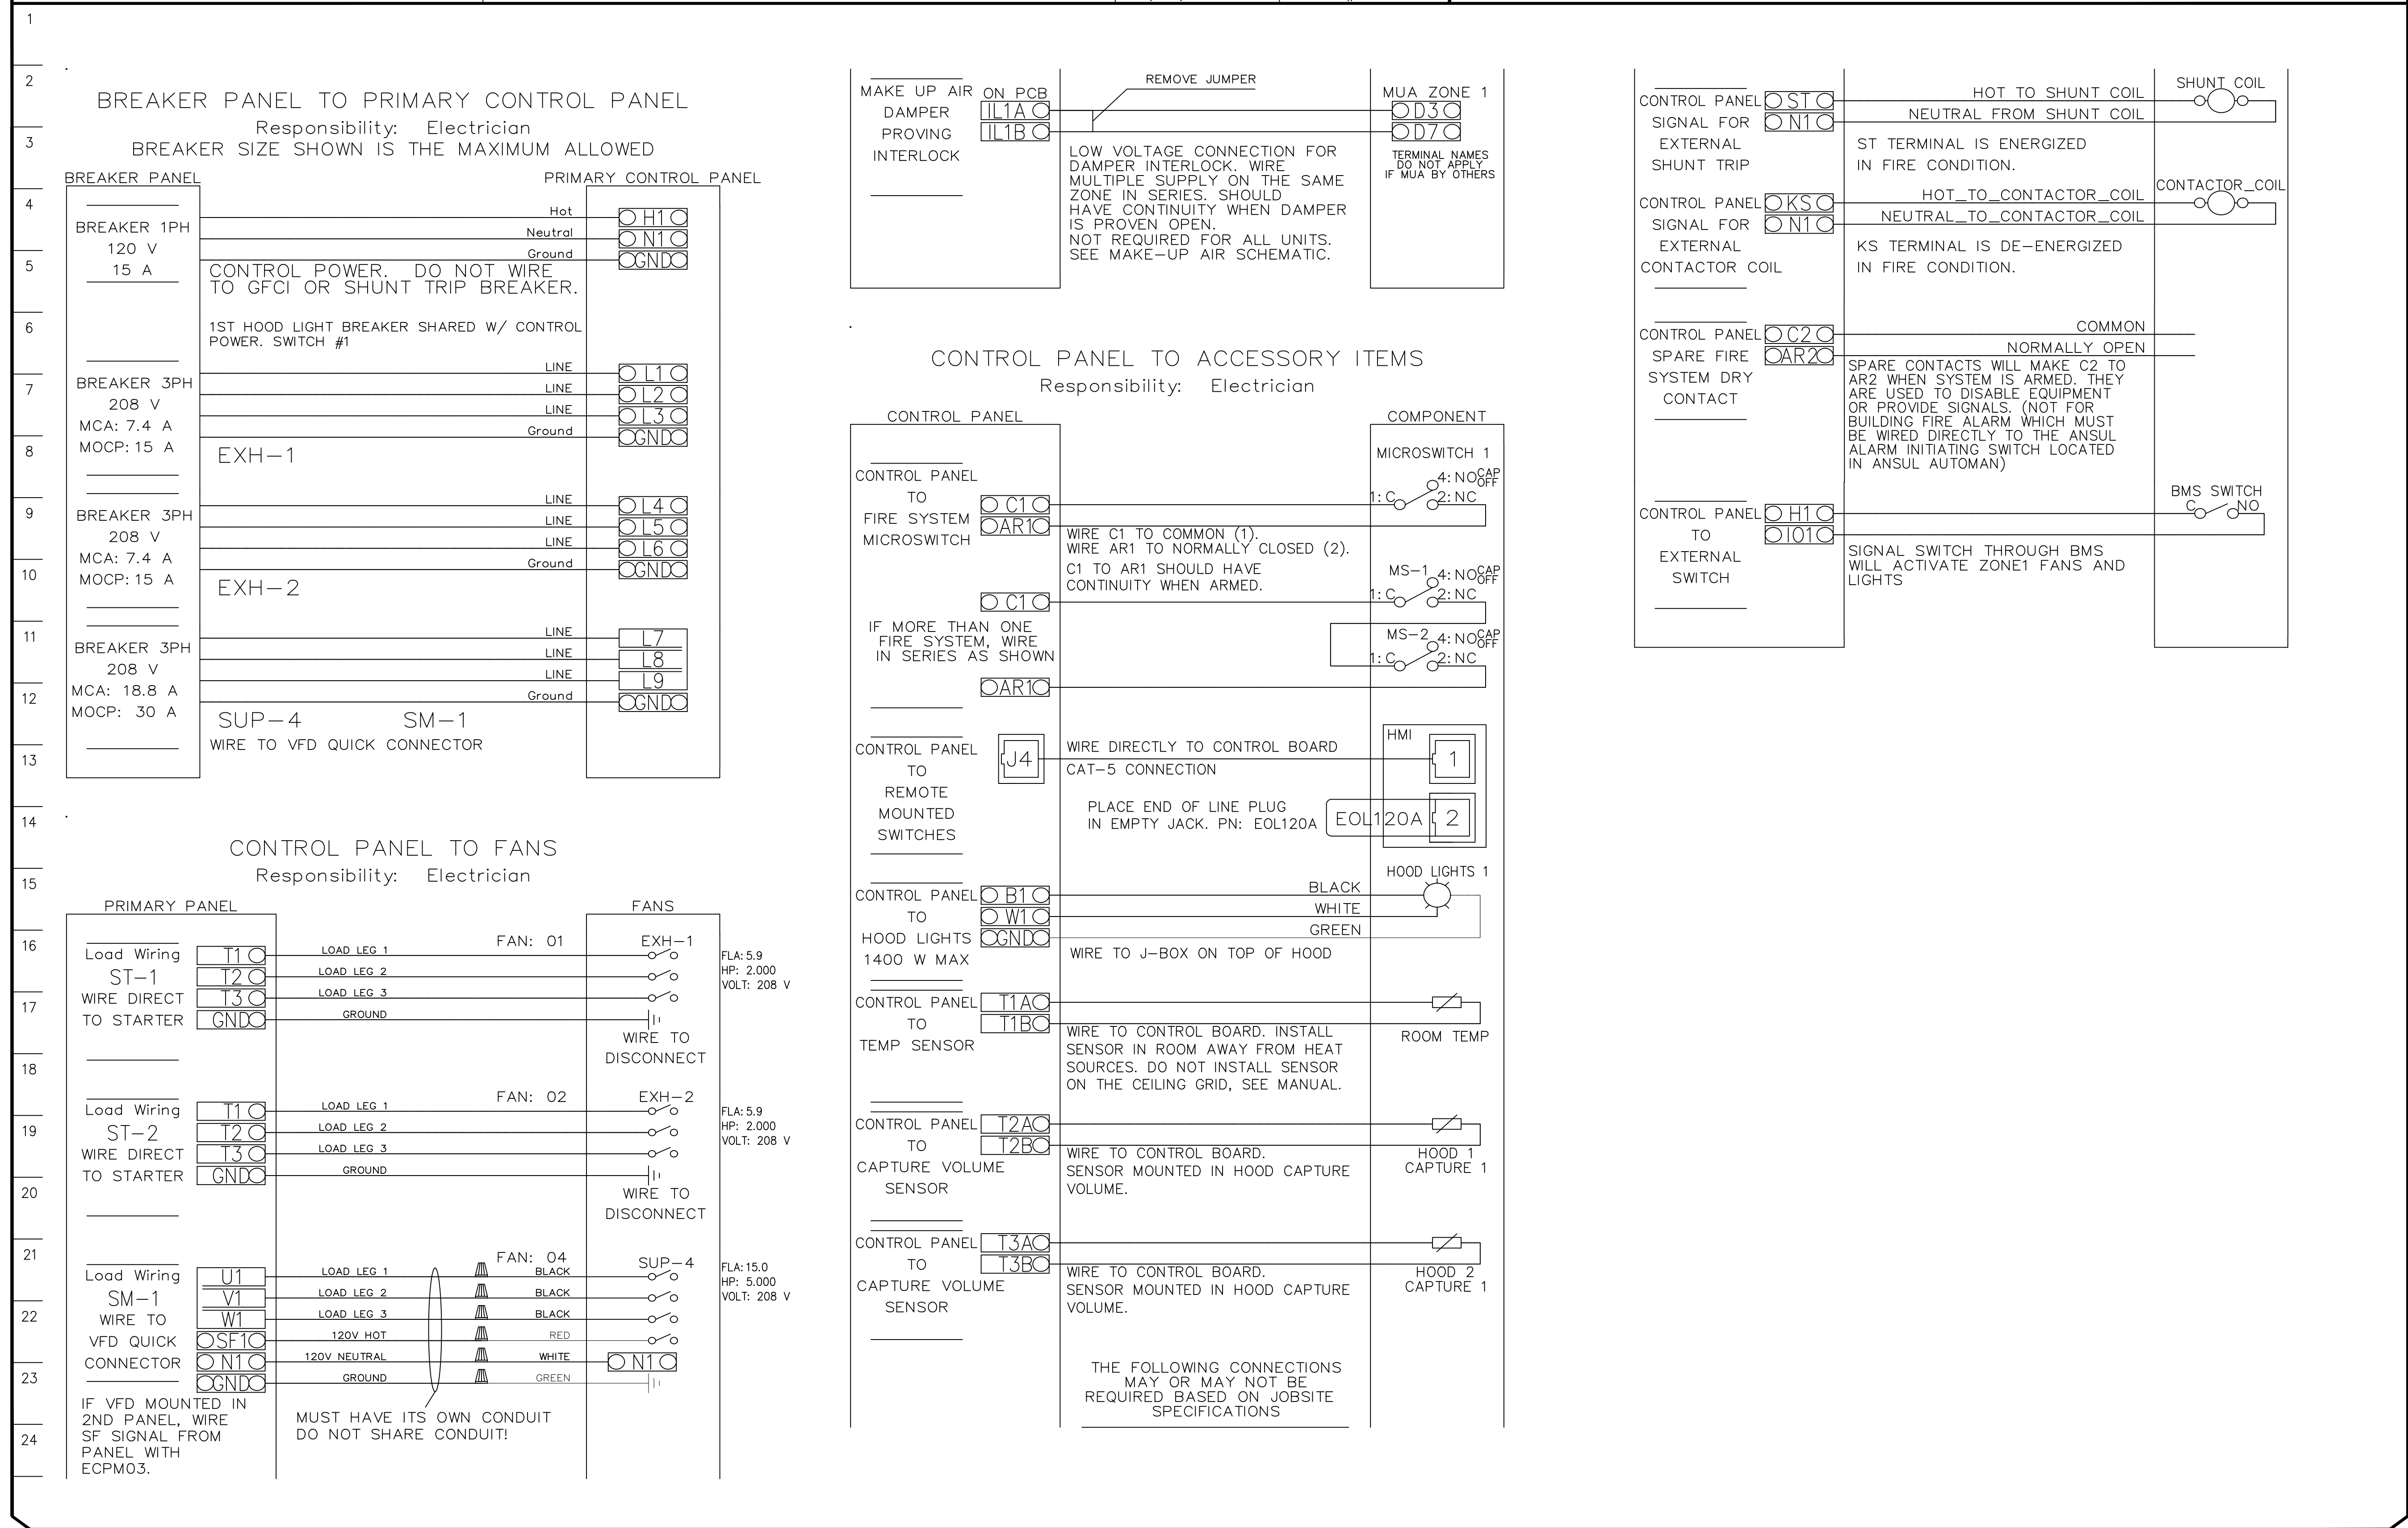

**PANDA EXPRESS, INC.**  
1683 Walnut Grove Ave.  
Rosemead, California  
91770  
Telephone: 626.799.9898  
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

[illegible]

DRAWN BY: KB

PANDA PROJECT #:	S8-22-D8193
PANDA STORE #:	-
ARCH PROJECT #:	20044.021

FOR REFERENCE ONLY



# PANDA EXPRESS

TRUE WARM & WELCOME  
1485 MAIN ST.  
HAMILTON, OH 45013

M-406

HOOD DETAIL PLAN

TRUE WARM &amp; WELCOME 2300 R5

