-	20		
Scale: NO SCALE	M-501		

-	16		
Scale: NO SCALE	M-501		

-	4		
Scale: NO SCALE	M-501		

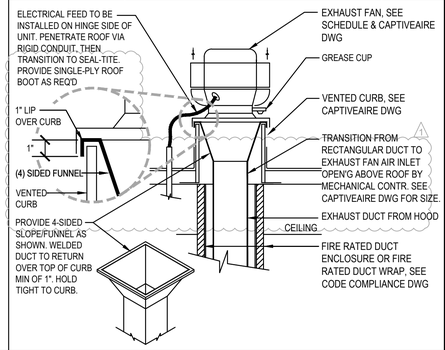

-	19		
Scale: NO SCALE	M-501		

-	15		
Scale: NO SCALE	M-501		

-	7		
Scale: NO SCALE	M-501		

GREASE EXHAUST FAN DETAIL	3		
Scale: NO SCALE	M-501		

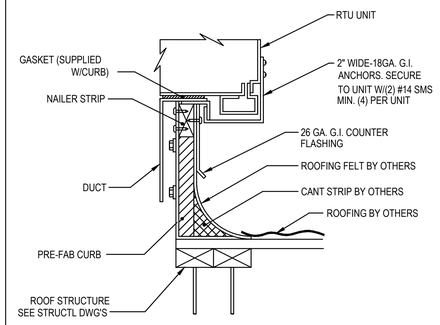

-	18		
Scale: NO SCALE	M-501		

-	14		
Scale: NO SCALE	M-501		

RTU UNIT CURB DETAIL	2		
Scale: NO SCALE	M-501		

SEQUENCE OF OPERATIONS:
UPON ACTIVATION OF THE KITCHEN HOOD ANSUL SYSTEM, THE DRY CONTACT WITHIN THE HOOD CONTROL PANEL SHALL OPEN AND SEND A CONTROL SIGNAL FOR ROOFTOP UNIT SHUTDOWN. SHUTDOWN SHALL OCCUR VIA AN ISOLATION RELAY TO THE (3) ROOFTOP UNITS SUPPLYING MAKE-UP AIR TO THE HOOD. E.C. TO PROVIDE CABINET, RELAY, TRANSFORMER AND ALL NECESSARY CONDUIT AND WIRING IN ORDER TO PROVIDE A. COMPLETE, FULLY FUNCTIONING SYSTEM.

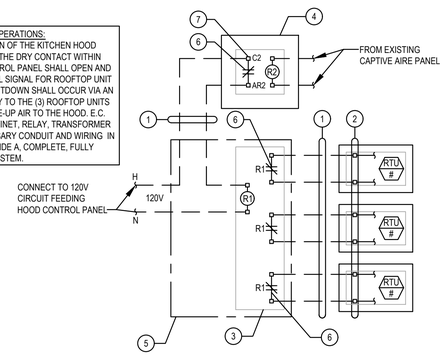

LEGEND

1. (2) #12 CONTROL WIRES IN 1/2" CONDUIT BY E.C.
2. M.C. TO CONNECT INTO REMOTE UNIT SHUTDOWN TERMINAL ON CARRIER ROOFTOP UNIT CONTROL BOARD AND REMOVE JUMPER. REFER TO MANUFACTURER FOR ADDITIONAL INFORMATION.
3. DPDT 120V RATED RELAY BY E.C. ENERGIZE FOR FAILSAFE OPERATION.
4. HOOD CONTROL PANEL AT KITCHEN.
5. 12X12X6 NEMA 1 CABINET MOUNTED ON WALL ADJACENT TO KITCHEN HOOD BY E.C.
6. N.O. DRY CONTACT (SHOWN ENERGIZED) THAT OPENS IN FIRE CONDITIONS.
7. 120V RATED DRY CONTACT WITHIN CAPTIVE AIRE PANEL.

-	17		
Scale: NO SCALE	M-501		

-	13		
Scale: NO SCALE	M-501		

RTU CONTROL WIRING DIAGRAM	5		
Scale: NO SCALE	M-501		

RETURN PLENUM	1		
Scale: NO SCALE	M-501		

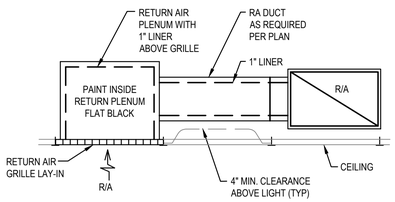

PANDA EXPRESS, INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

1	BID SET	2023-05-02

DRAWN BY:

PANDA PROJECT #: S4-24-D22020
ARCH PROJECT #: P7377

Plans Prepared By
CPH, LLC.
500 West Fulton St.
Sanford, Fl. 32771
Ph: 407.322.6841
Licenses:
Eng. C.O.A. No. 3215
Survey L.B. No. 7143
Arch. Lic. No. AA2600926
Lndscp. Lic. No. LC0000298
www.cphcorp.com
A Full Service A & E Firm

PANDA EXPRESS

PANDA END CAP
3301 W HILLSBORO BLVD
DEERFIELD BEACH, FL 33442

M-501

MECHANICAL DETAILS

PANDA HOME 2600 R4/DAB